


Gratz Borough Water Company

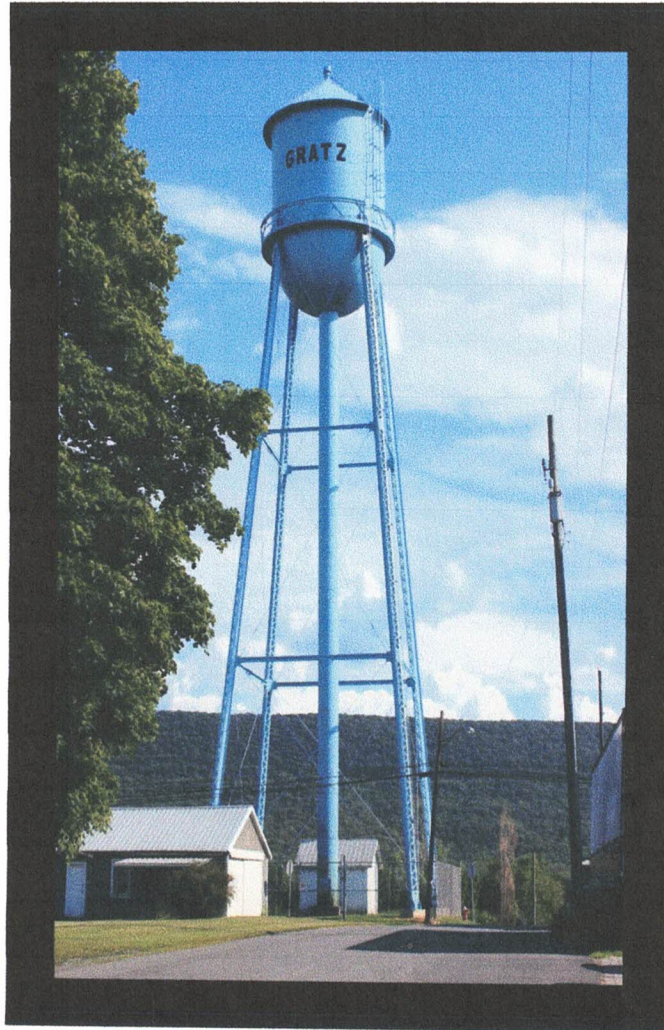

2021

Annual Report

Drinking Water Quality

Gratz Borough P.W.S.I.D. 7220005



2021 _____ ANNUAL DRINKING WATER QUALITY REPORT

PWSID #: 722005 _____ NAME: Gratz Borough Water Company _____

Este informe contiene información importante acerca de su agua potable. Haga que alguien lo traduzca para usted, ó hable con alguien que lo entienda. (This report contains important information about your drinking water. Have someone translate it for you, or speak with someone who understands it.)

WATER SYSTEM INFORMATION:

This report shows our water quality and what it means. If you have any questions about this report or concerning your water utility, please contact Tim Leshner _____ at 717-422-1298 or tim@gratzboro.com _____. We want you to be informed about your water supply. If you want to learn more, please attend any of our regularly scheduled meetings. They are held The second Tuesday of the month at 7:00 at the Gratz Borough Office. _____.

SOURCE(S) OF WATER:

Our water source(s) is/are: (Name-Type-Location)

Bower Spring

Cold Spring

Municipal Well #1

A Source Water Assessment of our source(s) was completed by the PA Department of Environmental Protection (Pa. DEP). The Assessment has found that our source(s) of is/are potentially most susceptible to [insert potential Sources of Contamination listed in your Source Water Assessment Summary]. Overall, our source(s) has/have [little, moderate, high] risk of significant contamination. A summary report of the Assessment is available on the Source Water Assessment Summary Reports eLibrary web page: www.elibrary.dep.state.pa.us/dsweb/View/Collection-10045. Complete reports were distributed to municipalities, water supplier, local planning agencies and PADEP offices. Copies of the complete report are available for review at the Pa. DEP South Central

Regional Office, Records Management Unit at (717) 705-4700.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the *Safe Drinking Water Hotline* (800-426-4791).

DETECTED SAMPLE RESULTS:

Chemical Contaminants								
Contaminant	MCL in CCR Units	MCLG	Level Detected	Range of Detections	Units	Sample Date	Violation Y/N	Sources of Contamination
Barium	2	2	0.0129	0.0129	mg/l	5/17/21	n	Dishcharge of Drilling Waste
Haloacetic Acids	60	n/a	.0094	0.00497-0.00994	mg/l	10/01/21	n	By product of drinking water disinfection
Nickel	0.2	0.2	0.0008	0.0008	mg/l	10/1/22	n	
Nitrate	10	10	1.4	1.4	mg/l	9/30/21	n	Runoff from fertilizer
Monochloroacetic Acid	2	2	0.00994	0.00497-0.00994	mg/l	10/1/21	n	
Chloroform			0.00082	0.00041-0.00082	mg/l	10/1/21	n	
Trihalomethanes	0.80	n/a	0.00236	0.00118-0.00236	mg/l	10/1/21	n	Byproduct of water chlorination

*EPA's MCL for fluoride is 4 ppm. However, Pennsylvania has set a lower MCL to better protect human health.

Entry Point Disinfectant Residual							
Contaminant	Minimum Disinfectant Residual	Lowest Level Detected	Range of Detections	Units	Sample Date	Violation Y/N	Sources of Contamination
Chlorine	0.40	0.41	0.41-1.04	ppm	2/23/21	n	Water additive used to control microbes.

Lead and Copper							
Contaminant	Action Level (AL)	MCLG	90 th Percentile Value	Units	# of Sites Above AL of Total Sites	Violation Y/N	Sources of Contamination
Lead	15	0	0.001	ppb	0	n	Corrosion of household plumbing.
Copper	1.3	1.3	0.64	ppm	0	n	Corrosion of household plumbing.

Microbial (related to Assessments/Corrective Actions regarding TC positive results)					
Contaminants	TT	MCLG	Assessments/ Corrective Actions	Violation Y/N	Sources of Contamination
Total Coliform Bacteria	Any system that has failed to complete all the required assessments or correct all identified sanitary defects, is in violation of the treatment technique requirement	N/A	See detailed description under "Detected Contaminants Health Effects Language and Corrective Actions" section	n	Naturally present in the environment.

Microbial (related to E. coli)					
Contaminants	MCL	MCLG	Positive Sample(s)	Violation Y/N	Sources of Contamination
<i>E. coli</i>	Routine and repeat samples are total coliform-positive and either is <i>E. coli</i> -positive or system fails to take repeat samples following <i>E. coli</i> -positive routine sample or system fails to analyze total coliform-positive repeat sample for <i>E. coli</i> .	0	0	n	Human and animal fecal waste.
Contaminants	TT	MCLG	Assessments/ Corrective Actions	Violation Y/N	Sources of Contamination
<i>E. coli</i>	Any system that has failed to complete all the required assessments or correct all identified sanitary defects, is in violation of the treatment technique requirement	N/A	See description under "Detected Contaminants Health Effects Language and Corrective Actions" section	n	Human and animal fecal waste.

Raw Source Water Microbial					
Contaminants	MCLG	Total # of Positive Samples	Dates	Violation Y/N	Sources of Contamination
<i>E. coli</i>	0	0	n/a	n	Human and animal fecal waste.

DETECTED CONTAMINANTS HEALTH EFFECTS LANGUAGE AND CORRECTIVE ACTIONS:

No other additional health affects language is required based on water test results.

OTHER VIOLATIONS:

Late CCR Report

Late Monitoring and Reporting for Chlorine and Ground Water RuleG

EDUCATIONAL INFORMATION:

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban stormwater run-off, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems.
- Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, EPA and DEP prescribes regulations which limit the amount of certain contaminants in water provided by public water systems. FDA and DEP regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's *Safe Drinking Water Hotline* (800-426-4791).

Information about Lead

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Gratz Borough Water Company _____ is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the *Safe Drinking Water Hotline* or at <http://www.epa.gov/safewater/lead>.

OTHER INFORMATION:
